GTM Research Cost and LCOE by Generation Technology, 2009-2020

November 2011

Prepared by:

Brett Prior

Senior Analyst

(617) 500-4385

prior@gtmresearch.com



LCOE Inputs

2011 LCOE Inputs for a hypothetical plant in the Southwest US (DNI of 6.85 kWh/m^2/day)

Technology	Trou	ah	Tow	er	CLFR	PV: CdTe, fixed	PV: Mono, 1- axis	PV: Multi, fixed	High CPV (lens)	Wind	Gas CC
Cooling Storage	Wet No	Dry No	Dry No	Dry Yes	Dry No				(roney		
Technology Assumptions											
Project Capacity (MW)	250	250	250	250	250	250	250	250	250	250	25
EPC Cost (\$/kW-ac)	\$4,067	\$4,249	\$4,250	\$5,136	\$3,482	\$2,791	\$3,893	\$2,856	\$2,791	\$2,205	\$90
Other Owner's Costs (\$/kW-ac)*	<u>\$407</u>	<u>\$425</u>	<u>\$425</u>	<u>\$514</u>	<u>\$348</u>	<u>\$279</u>	<u>\$389</u>	<u>\$286</u>	<u>\$279</u>	<u>\$220</u>	<u>\$9</u>
Capital Cost (\$/kW-ac)	\$4,474	\$4,674	\$4,675	\$5,650	\$3,830	\$3,071	\$4,282	\$3,141	\$3,071	\$2,425	\$1,00
Fixed O&M (\$/kW-ac)	\$66	\$66	\$55	\$65	\$48	\$32	\$36	\$30	\$36 [*]	\$60	\$
Fixed O&M Escalation	2.5%	2.5%	2.5%	2.5%	2.5%	2.5%	2.5%	2.5%	2.5%	2.5%	2.5%
Variable O&M (\$/MWh)	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$
Variable O&M Escalation	2.5%	2.5%	2.5%	2.5%	2.5%	2.5%	2.5%	2.5%	2.5%	2.5%	2.5%
Fuel Cost (\$/MBtu)	\$ 0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$
Fuel Cost Escalation	2.5%	2.5%	2.5%	2.5%	2.5%	2.5%	2.5%	2.5%	2.5%	2.5%	2.5%
Heat Rate (Btu/kWh)	0	0	0	0	0	0	0	0	0	0	700
Capacity Factor	27%	26%	30%	43%	25%	21%	27%	20%	25%	35%	90%
Misc Escalation	2.5%	2.5%	2.5%	2.5%	2.5%	2.5%	2.5%	2.5%	2.5%	2.5%	2.5%
Degradation	0.0%	0.0%	0.0%	0.0%	0.0%	0.8%	0.5%	0.5%	0.5%	0.0%	0.09


Financial/Economic Asumption	ons										
Debt Percentage	50%	50%	50%	50%	50%	50%	50%	50%	50%	50%	60%
Debt Rate	7%	7%	7%	7%	7%	7%	7%	7%	7%	7 %	7%
Debt Term (years)	20	20	20	20	20	20	20	20	20	20	20
Economic Life (years)	25	25	25	25	25	25	25	25	25	25	25
Percent 5-year MACRS	100%	100%	100%	100%	100%	100%	100%	100%	100%	100%	100%
Tax Rate	35%	35%	35%	35%	35%	35%	35%	35%	35%	35%	35%
Cost of Equity	12%	12%	12%	12%	12%	12%	12%	12%	12%	12%	12%

Incentives											
ITC	30%	30%	30%	30%	30%	30%	30%	30%	30%	30%	30%
ITC Depr Basis	85%	85%	85%	85%	85%	85%	85%	85%	85%	85%	85%


^{*} Other Owner's Costs includes site permits & preparation, project management costs, sales taxes, land, property taxes, insurance, architectural costs, interconnection fees, public relations, debt reserve, lender fees, and other administrative costs Source: GTM Research

GTM RESEARCH


Capital Cost per Watt (PV costs converted to AC)

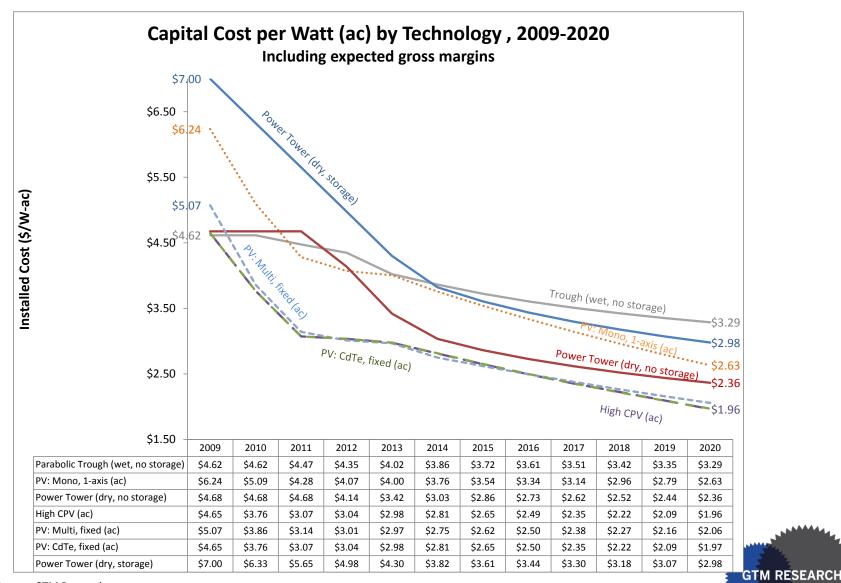

LCOE for a plant in US Southwest by technology

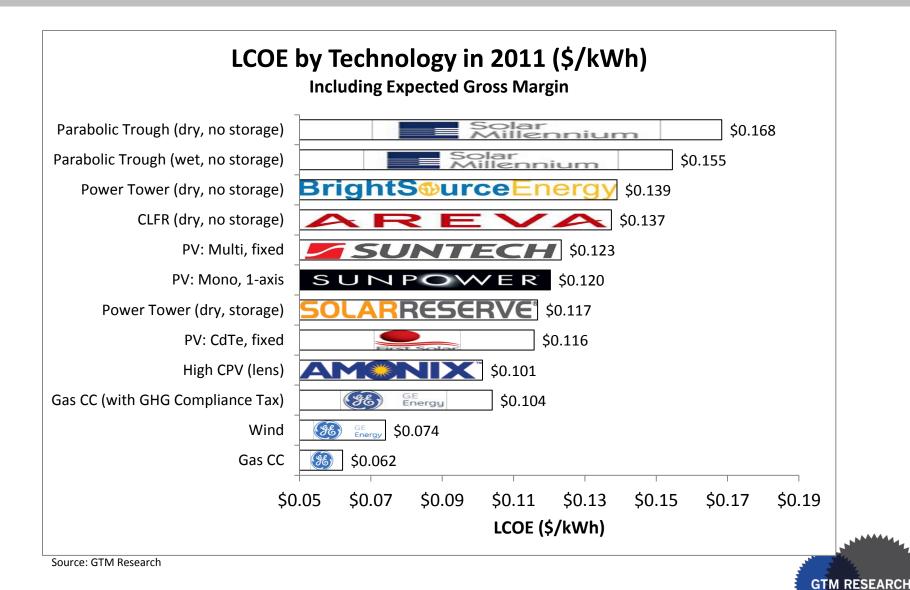

LCOE Forecast by Technology

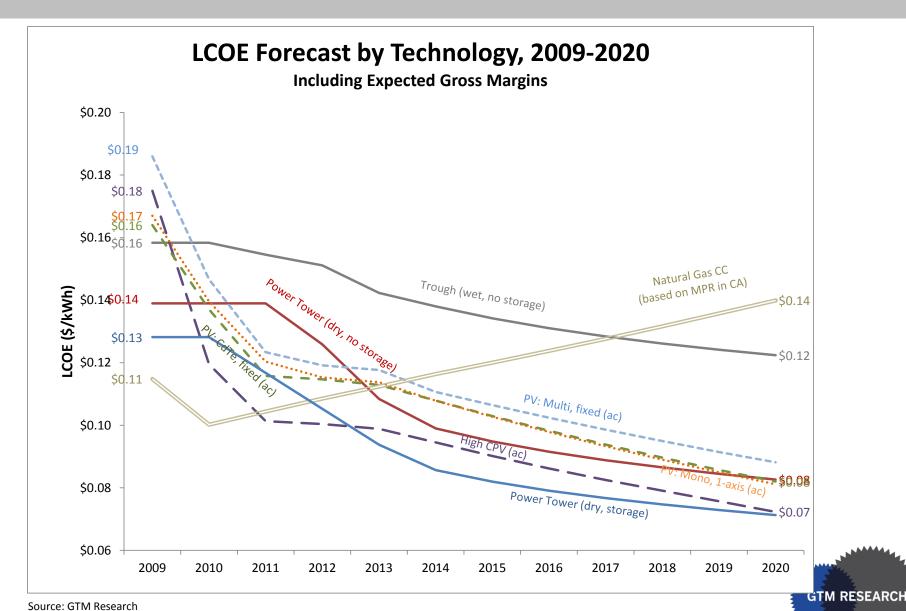

Shortcomings of LCOE


- LCOE allows for comparison across technologies, but it ignores two of the key characteristics for generation assets:
 - Dispatchability
 Natural gas plants can provide firm power, wind and solar plants cannot.
 LCOE also ignores the capacity payments that are associated with operating a firm generating asset
 - Generation Time-of-Day (TOD)
 LCOE doesn't consider the time of day when the power is generated. This can be a significant driver of profitability as many PPAs include TOD factors which determine the effective revenue earned per kWh



LCOE doesn't consider differing revenue/kWh from TOD effects


Time of Delivery (TOD)


Solar systems earn higher payments due to TOD multiplier effects. In this example, a PPA with a base rate of \$0.10/kWh pays 2.0x (\$0.20/kWh) for power generated between 1 pm to 8 pm in the summer.

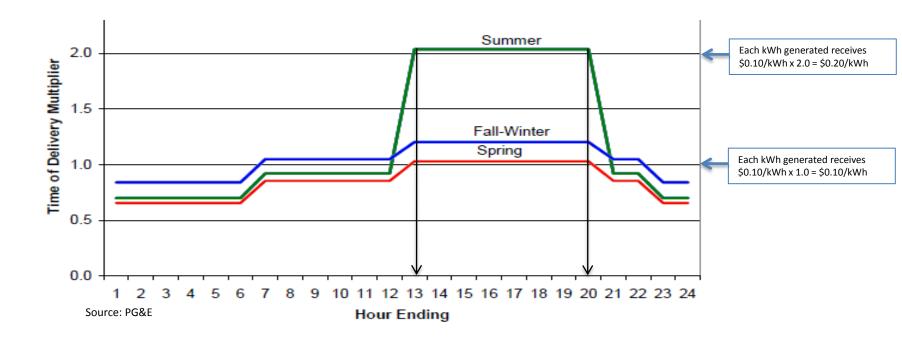



CSP with storage can earn higher revenue & profits per kWh than PV

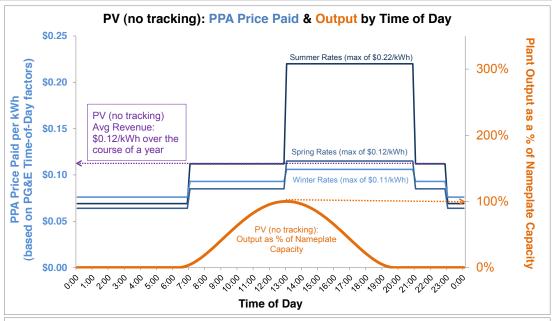

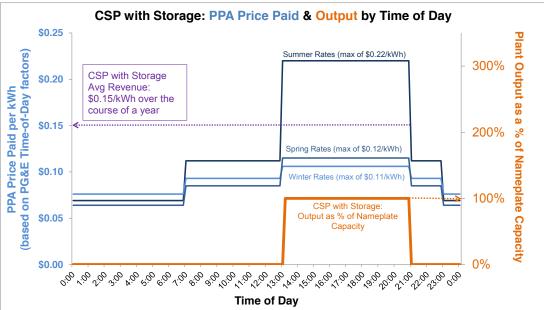

Project Economics: PV vs. CSP with Storage								
	PV	CSP						
	(no tracking)	(with storage)						
PPA Price (\$/kWh)	\$0.10	\$0.10						
Avg TOD Factor	1.2x	1.5x						
Avg Revenue (\$/kWh)	\$0.12	\$0.15						
Levelized Cost (\$/kWh)	<u>\$0.11</u>	<u>\$0.12</u>						
Avg Profit (\$/kwh)	\$0.01	\$0.03						
Equity Investor IRR	10%	20%						
	_							
= better technology choice								

